


Calibrated MC_F

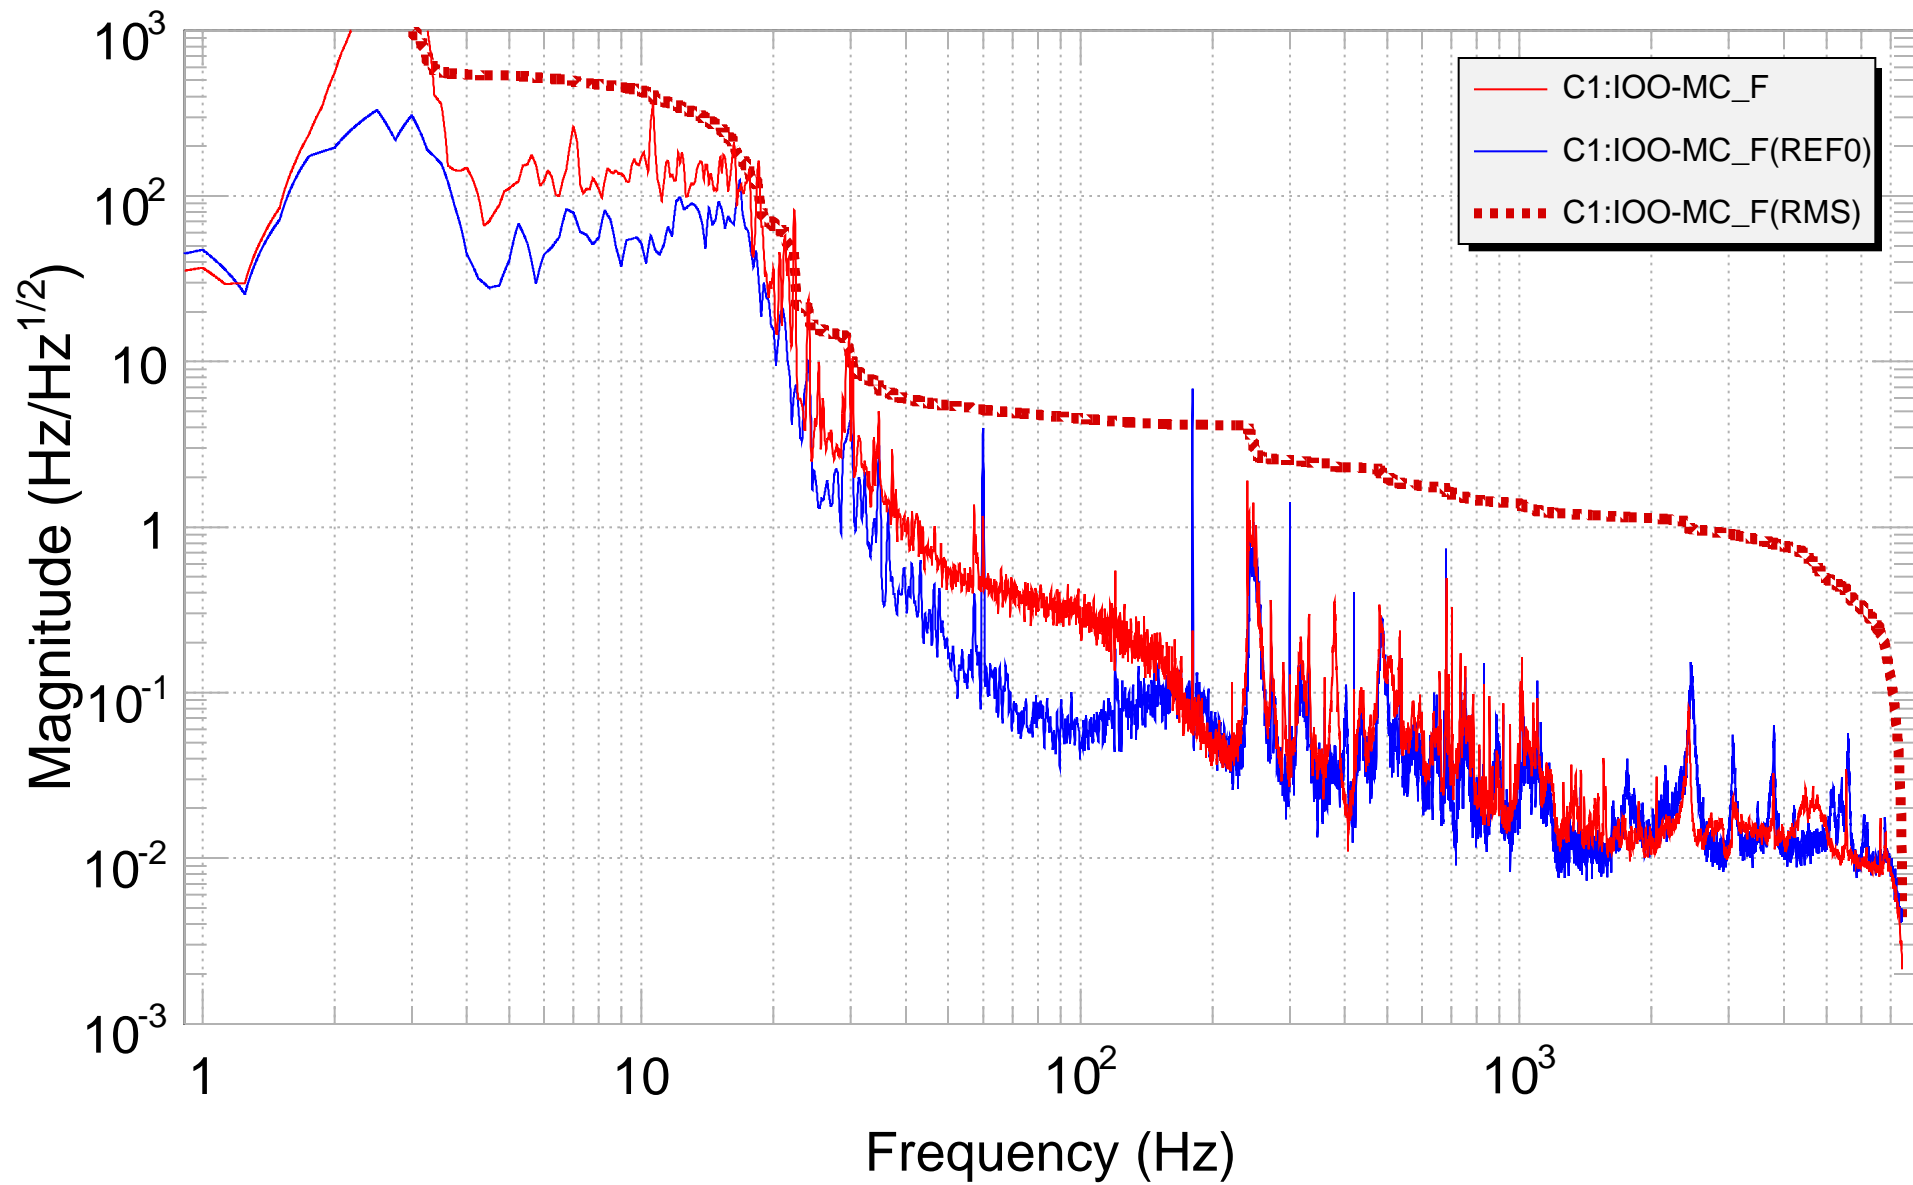

*T0=16/01/2009 19:30:30

Avg=14/Bin=5L

*BW=0.187493